

## TruView Venturi Fume Hood

Teaching/Demonstration Bench Hood with Combination Sash — Double-sided

(indicate fittings/fixtures required)  
(hole plugged if no fitting specified)

(indicate fittings/fixtures required)  
(hole plugged if no fitting specified)

[Vacuum Breaker]

[Vacuum Breaker]

[Vacuum Breaker]

[Vacuum Breaker]

[Option K - Fan/Blower Switch]

**Light/Sash Stop Controller**

[Option A2/A3 Alarm]

[Water]

[Water]

**120VAC GFCI Double Duplex**

**120VAC GFCI Double Duplex**

**Receptacles:** (pick one)

**S** Spec. Grade GFCI

**Receptacle Color:** (pick one)


**K** Black     **V** Ivory  
 **W** White     **G** Grey  
 **R** Red

**Wiring:** (pick if required)

**U** Pre-wired - Top of Hood  
 **U2** Pre-wired - Vapor Proof

**Plumbing:** (pick one if required)

**RU** Pre-plumbed to Top with hoses  
 **RD** Pre-plumbed to Bottom with hoses

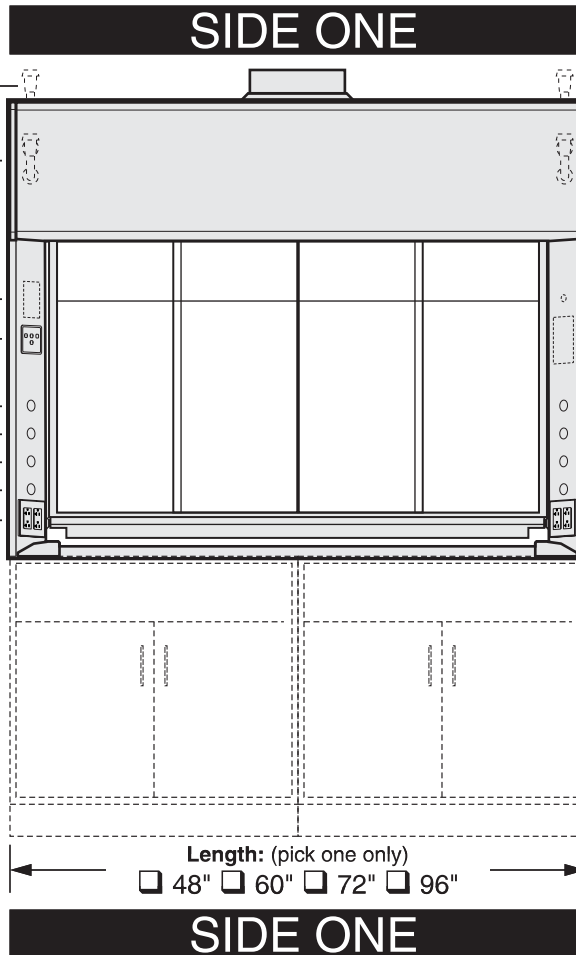

**Required:** (pick one from each group – will be applied to both sides)

**Rear Window Configuration** (pick one)  
 **CB** Glass Back Wall & Baffles

**Interior Liner Material** (pick one)  
 **G** Kemglass (Fiberglass Reinforced Polyester)

**Sash Frame** (pick one)  
 **M** Powder Coated Steel Frame  
 **S** Type 304L Stainless Steel Frame

**Sash Glass** (pick one)  
 **G1** Laminated Safety Glass  
 **G2** Tempered Safety Glass

**Service Fitting Valve Type** (pick one)  
 **F4** Front Load (Watersaver or FAR)

**Hood Configuration** (pick one)  
 **SA** Stand Alone (Free standing)  
 **EU** End Unit (Side One Right End – Side Two Left End)  
 **AD** Add-on (Middle of run)

**Options:** (pick all required – will be applied to both sides)

**N1** Solid Left Window (Kemglass panel w/frame) } (pick one only)  
 **N2** Solid Right Window (Kemglass panel w/frame) }  
 **N3** Solid L & R Window (Kemglass panel w/frame)

**A2** Air Alert 600 Alarm } (pick one only)  
 **A3** Air Alert 300 Alarm }  
 **L** Sash Stop Label

**D** Distillation Rack Preparation

**T** Tissue Screen

**K** Fan/Blower Switch (1hp motor rated)

**O** Stainless Steel Airfoil - Type 304L  
 **O2** Stainless Steel Airfoil - Type 316L  
 **Q** Stainless Steel Sash Pulls  
 **C** Stainless Steel Duct Collar

**R1** Auto Sash Return } (pick one only)  
 **R3** Proximity Sash Operator }

**V** Modified By-pass for VAV Control System  
Controller Manf: \_\_\_\_\_  
Model: \_\_\_\_\_ Minimum CFM:

Overall Length	Back Config.	Hood Liner	Sash Frame	Sash Glass	Service Fittings	Electrical Fixtures	Hood Config.	Options (separated by commas)	COLOR	ITEM NO.	QUANTITY
V56F	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>				


# TruView Venturi Fume Hood

# V56F...

Teaching/Demonstration Bench Hood with Combination Sash — Double-sided

(indicate fittings/fixtures required)  
(hole plugged if no fitting specified)

(indicate fittings/fixtures required)  
(hole plugged if no fitting specified)

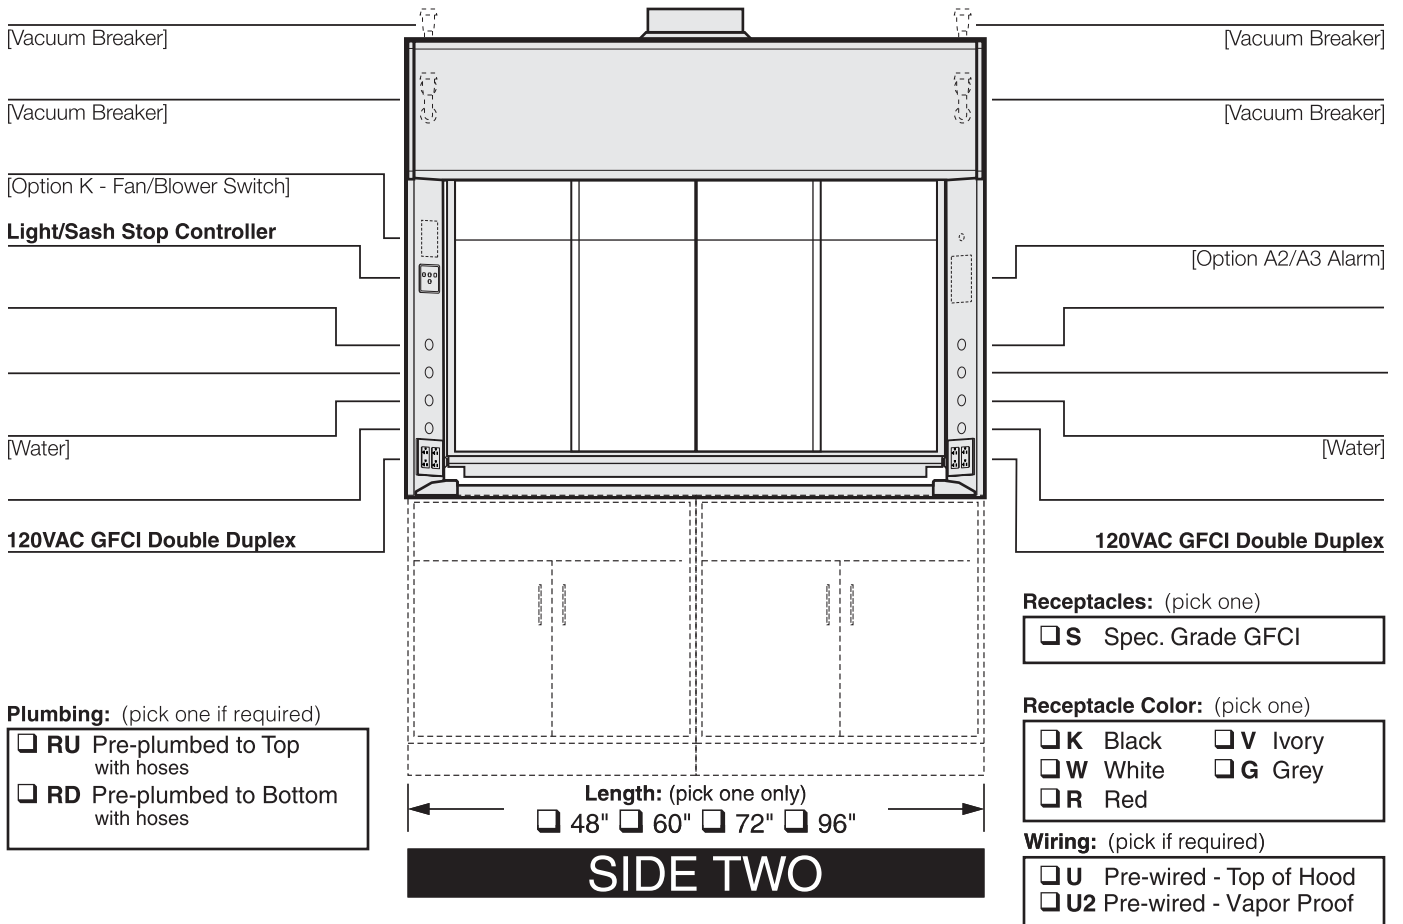

**See Side One for Part Number & Options**

ITEM NO.	
----------	--

# Technical Information

# V56F...


## Airflow (CFM) Requirements (Values in chart are for ONE SIDE - Double values for entire superstructure)

Face Velocity	18" High Sash Opening								Sash Closed – Panels Full Open							
	4'-0" / 48"		5'-0" / 60"		6'-0" / 72"		8'-0" / 96"		4'-0" / 48"		5'-0" / 60"		6'-0" / 72"		8'-0" / 96"	
	CFM	SP	CFM	SP	CFM	SP	CFM	SP	CFM	SP	CFM	SP	CFM	SP	CFM	SP
100 FPM	502	0.15	656	0.19	810	0.24	1118	0.16	424	0.11	567	0.14	709	0.19	995	0.13
80 FPM	401	0.10	525	0.13	648	0.16	895	0.11	339	0.07	453	0.09	568	0.12	796	0.09
60 FPM	301	0.06	394	0.07	486	0.09	671	0.06	254	0.04	340	0.05	426	0.07	597	0.05
50 FPM	251	0.04	328	0.05	405	0.07	559	0.04	212	0.03	284	0.04	355	0.05	498	0.04


Static pressures shown are for the pressure drop through the hoods only. The total pressure drop through the hood and the duct system must be calculated to select the proper exhaust fan.

## ANSI Z9.5 Minimum Flow Rate (Values in chart are for ONE SIDE - Double values for entire superstructure)


Inside Depth	150 Air Changes/Hour				375 Air Changes/Hour			
	4'-0" / 48"	5'-0" / 60"	6'-0" / 72"	8'-0" / 96"	4'-0" / 48"	5'-0" / 60"	6'-0" / 72"	8'-0" / 96"
24" deep	70 CFM	90 CFM	110 CFM	145 CFM	170 CFM	220 CFM	265 CFM	365 CFM

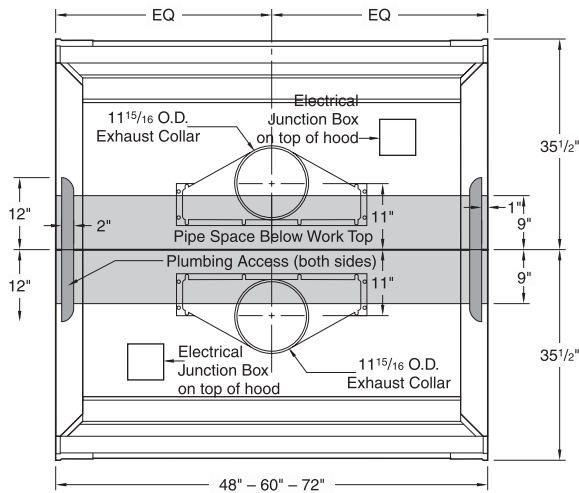


4'-5'-6' Rough-in

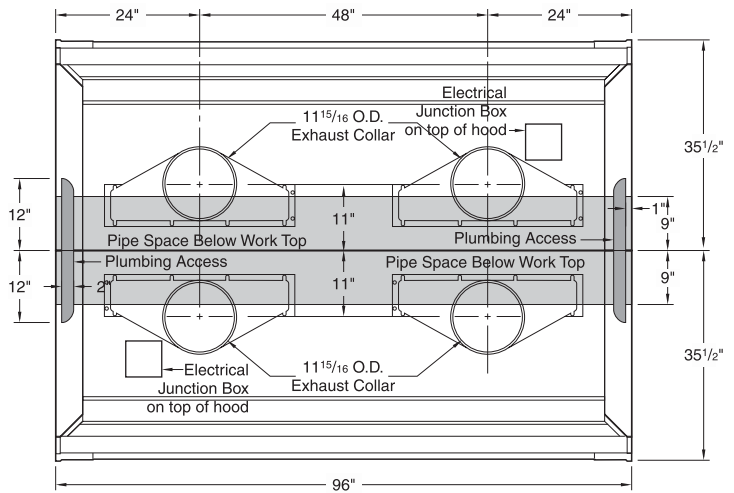

8' Rough-in

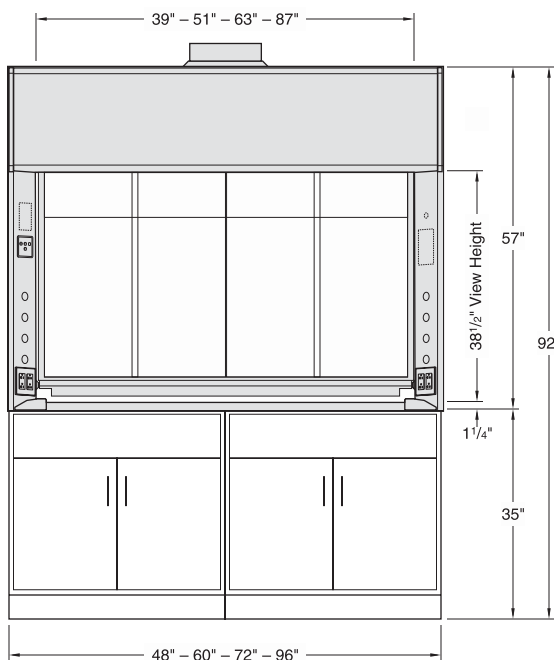

Elevation

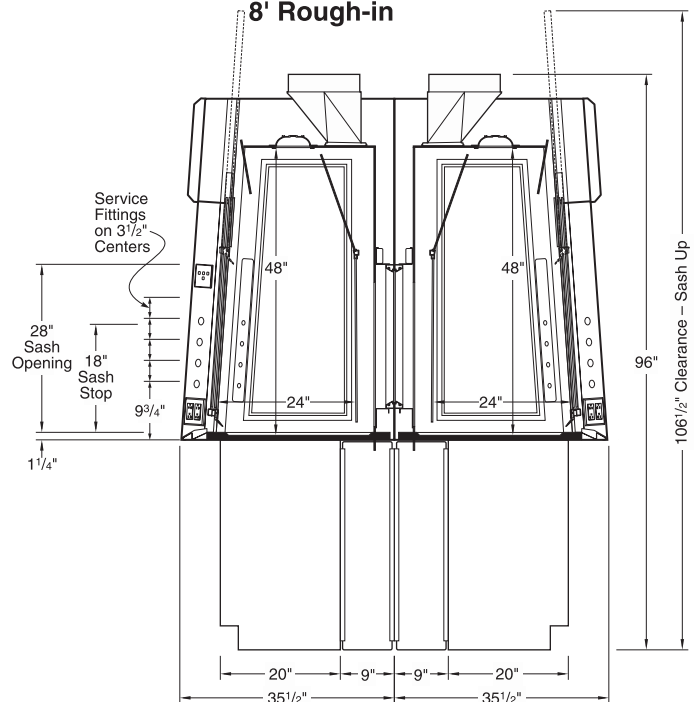

Vertical Section